

# **EPC-1000**

## **Embedded PC Controller**



# **User Manual**

## **Servo Tech Inc**

1747 W. Roosevelt Rd. Suite 110  
Chicago, IL 60608

Ph: (312) 355-4853 Fax: (312) 355-2021  
[www.servotechinc.com](http://www.servotechinc.com)

# TABLE OF CONTENTS

1. About Your EPC-1000.....	3
1.1. Equipment.....	3
1.2. Technical Specifications.....	4
1.3. Connection Ports and Cables.....	5
2. Installing Your EPC-1000.....	6
2.1. Introduction.....	6
2.2. Hardware Requirements.....	7
2.3 Software Requirements.....	7
3. Using Your EPC-1000.....	8
3.1. Communication with Host PC.....	8
3.2. Setup.....	8
3.3. System Test.....	9
3.4. Creating an Executable Target/EPC Application.....	10
4. Examples.....	12
4.1. Application Using Two EPC-1000s with CAN Bus Card.....	12
4.2. Application Using EPC-1000 with CAN Bus Card and Cat ABL Box.....	13
4.3. Analog and Digital I/O Application Using Diamond (DMM-32-AT) Card.....	15
5. Contact Information.....	17

# 1. ABOUT YOUR EPC-1000

## 1.1. Included Equipment

-EPC Main Unit



-Cigarette Lighter Plug for 12VDC



-AC Adapter for 110VAC



## 1.2. Technical Specifications

Power Input	12VDC (110VAC Adapter included)
	2.0/5.5 mm Circular power jack
Dimensions	5.5 X 5.5 X 6.25 inches
CPU	On-board NS GX1-300 processor / Embedded low power NS Geode GX1-300 MHz processor (Different cpu boards available.)
Solid State Disk	64 MB Compact Flash (Different sizes available)
RAM	64 Mbytes SDRAM (Upgradeable to 128 MB)
BIOS	AWARD 256 KB Flash memory
Serial Port	One RS-232
Ethernet Interface	Intel 82559 chipset
	10/100 Mbps
	RJ45 standard connector
CAN Bus	CAN-AC2-104 from Softing
	Two D-Sub 9 pin connectors
	10....1000 kbit/s transfer rate
*Digital I/O Option	Diamond DMM-32-AT
OS	PC Dos 7 (Different OS Available)
Operating Temperature	-40 to 85 Celsius
Operating Humidity	0% to 90% relative humidity, noncondensing

**\*Additional PC/104 cards including Analog and Digital I/O can be added into EPC-1000. Please contact us for your requests and available options.**

**Different connector options are available. Ask us about rugged military version.**

# 1.3. Connection Ports and Cables


Industrial Connectors	Military Connector Options
-----------------------	----------------------------



## Power

Connector: 2.0/5.5mm jack, Military Bayonet 3p


Cable: Cigarette Lighter Plug for 12VDC (incl.)  
AC Adapter for 110VAC (incl.)



## Ethernet

Connector: RJ45

Cable: Crossover between 2 PCs  
UTP Network between PC and LAN





## RS232

Connector: D-Sub 9p, Military Bayonet 10p

Pin Lay Out:

1 –	Data Carrier Detect	-A
2 –	Receive Data	-B
3 –	Transmit Data	-C
4 –	Data Terminal Ready	-D
5 –	Ground	-E
6 –	Data Set Ready	-F
7 –	Request To Send	-G
8 –	Clear To Send	-H
9 –	Ring Indicator	-J

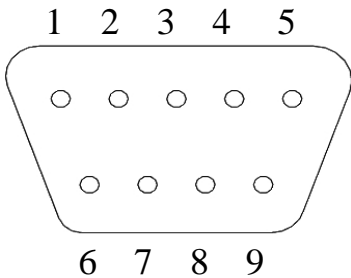



## CAN

Connector: D-Sub 9p, Military Bayonet 10p

Pin Lay Out:

2 –	CAN_Low	-B
5 –	CAN_Shield	-E
7 –	CAN_High	-G

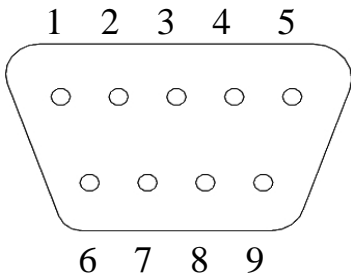

## 2. INSTALLING YOUR EPC-1000

### 2.1. Introduction


EPC is a convenient device for Embedded Control Development System. It has GX1-300 MHz onboard processor with low power, fanless performance. The stable Geode processor with onchip PCI VGA and Intel I82559ER high performance Ethernet chip provide power and functionality. EPC also has a stacked CAN bus board with two CAN cards. It has the provision for stacking additional I/O boards, which greatly enhances the range of real-time applications.

The EPC is a solution for prototyping, testing, and deploying real-time systems using standard PC hardware. It is an environment that uses an EPC, a host PC and a CAN bus for running real-time applications.

A Typical fully operational EPC set up looks like below. It has an EPC with or without a Host computer and a CAN Bus. Additional I/O boards can be stacked for customizing the EPC for your local needs.

EPC is compatible with XPC Target software from Matlab. Matlab requires a valid user license.

Figure shows a Hardware setup for Embedded Control Development System

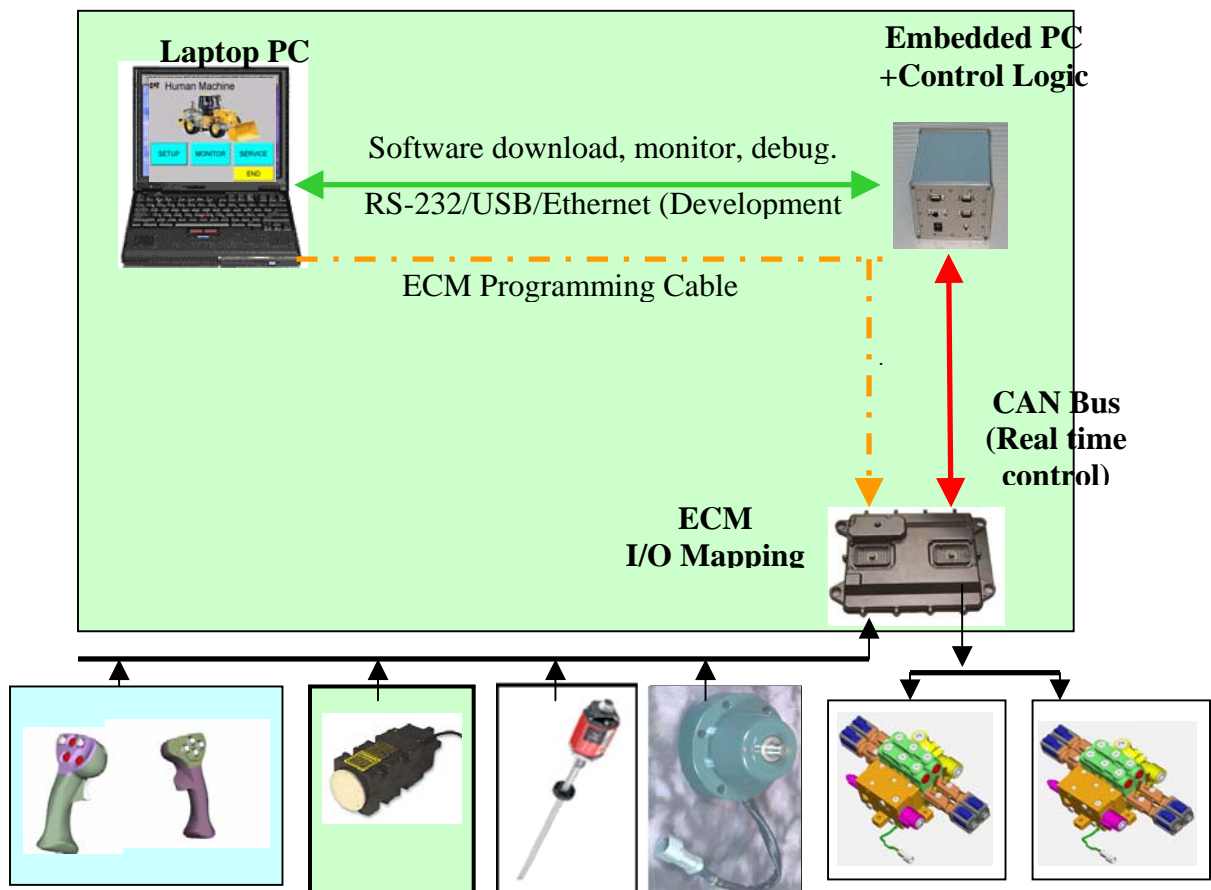

In this configuration, Electronic Control Module (ECM) acts as I/O mapping device between I/O signals and CAN bus. EPC reads input signals from CAN bus, executes the control logic and writes the output onto the CAN bus.

## 2.2. Hardware Requirements

Host PC can be a notebook or desktop computer.

The following table lists the minimum resources required on the host PC:

Hardware	Description
CPU	Pentium, Athlon or later
Peripherals	Hard disk drive with 60 Mbytes of free space One 3.5-inch floppy disk drive CD-ROM drive
RAM	128 Mbytes or more
Communication	One free serial port (COM1 or COM2) with a 9-pin serial cable or an Ethernet card with a cross over cable

## 2.3. Software Requirements

The following table lists the minimum software required on your host PC :

Software	Description
Operating system	Microsoft Windows XP (SP1) or Windows 2000
MATLAB	Version 6.5.1.199709 (R13) Service Pack 1
Simulink	Version 5.1(R13SP1)
Real-Time Workshop	Version 5.1(R13SP1)
Stateflow (optional)	Version 5.1.1(R13SP1)
State Flow Coder (optional)	Version 5.1.1(R13SP1)
xPC Target	Version 2.0.1(R13SP1)
xPC Target Embedded (optional)	Version 2.0.1(R13SP1)
C language compiler	Microsoft Visual C/C++ version 5.0 or higher

### 3. USING YOUR EPC-1000

#### 3.1. Host PC Communication

RS-232 communication uses a null modem cable and COM ports of the host and target PCs.

For TCP/IP communication, you must have a network adapter card correctly installed on the host PC (EPC already has an onboard Ethernet adapter). Connect the host and target computers with an unshielded twisted pair (UTP) cable to your local area network (LAN). You can directly connect host and target PCs with a crossover cable.

#### 3.2. Setup

EPC is set up for “Dosloader” mode by default.

At the Matlab command prompt, type `>> xPCsetup`


Then in EPC setup window as shown below, make the following selection:

```
CCompiler: VisualC
CompilerPath: C:\Program Files\Microsoft Visual Studio
CANLibrary: PC104
Target scope: Enabled
xPC target embedded option: "Dosloader"
```

For RS232, Select:

```
HostTarget com: RS232
RS232HostPort : COM1/COM2    (Pick default values)
RS232Baudrate: 115200        (Pick default values)
```

The recommended I/O base address for the CAN bus is “0X240

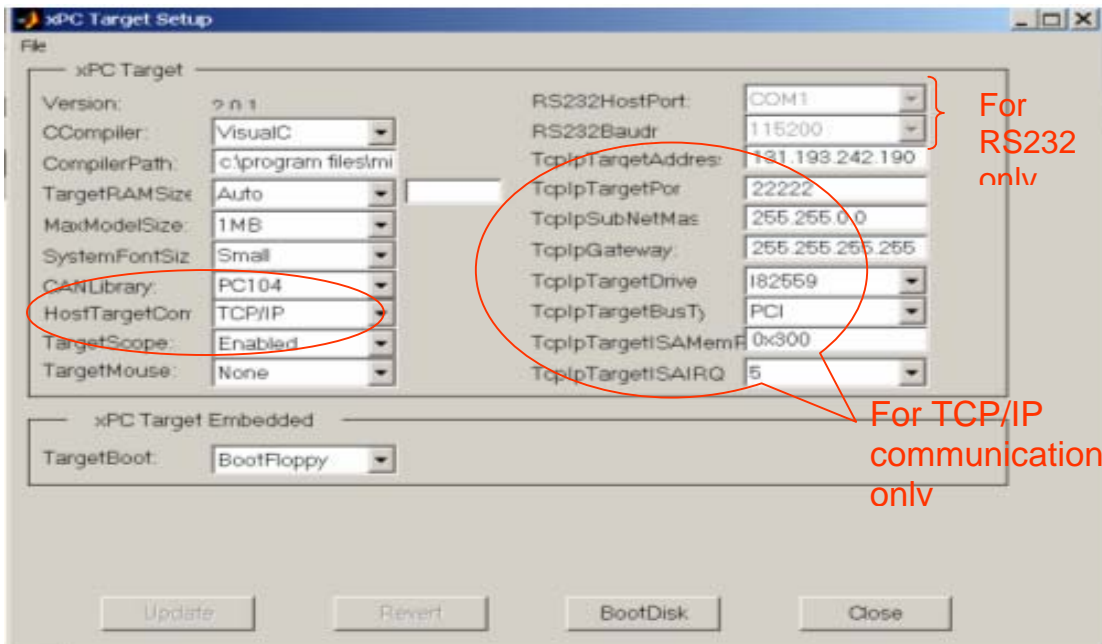



Then, click the Update button to update system environment and the boot floppy button in order to create the appropriate boot floppy disk.

### 3.3. System Test

In the MATLAB command prompt, type

```
>> xpctest
```

MATLAB runs the test script and displays messages indicating the success or failure of a test. If you use RS232 communication, the first test is skipped.

```
>>### xPC Target Test Suite 2.0.1
>>### Host-Target interface is: TCP/IP (Ethernet)
>>### Test 1, Ping target system using standard ping:... OK
>>### Test 2, Ping target system using xpctargetping:... OK
>>### Test 3, Reboot target using direct call: ..... OK
>>### Test 4, Build and download xPC Target application: ... OK
>>### Test 5, Check host-target communication for commands: .. OK
>>### Test 6, Download xPC Target application using OOP: ... OK
>>### Test 7, Execute xPC Target application for 0.2s: ... OK
>>### Test 8, Upload logged data and compare with simulation:. OK
>>### Test Suite successfully finished
```

#### **Ping Target System xPC Target Ping test:**

This test is an xPC Target ping to your target computer. If this test fails, try troubleshooting with the following procedure:

At the MATLAB Command prompt, type:

```
>>tg = xpc
```

Check the messages in the MATLAB window. MATLAB should respond with the following message.

```
xPC Object
```

```
Connected           = Yes
Application         = xpcosc
Mode                = Real-Time Single-Tasking
Status              = stopped
CPUoverload         = none
```

At the Matlab command prompt, type:

```
>> Xpctargetping
```

Matlab displays the following message

```
ans =
success
```

If the connection is resumed (Connected = Yes), then the connection is all right. If the connection is timing out consistently for a particular model, then the time out needs to be increased. If all of the tests were successful, you are ready to build and download a target application to the EPC.

### 3.4. Creating an Executable Target/EPC Application

### Host-Target Communication:

Typical steps involved in developing xPC code are as follows:

1. Download a target application from the host PC to the EPC computer.
2. Control -- Change properties and control the target application. This includes starting and stopping the target application, changing sample and stop times, and getting information about the performance of the target application through the communication link between host PC and EPC.
3. Parameter values -- Download parameter values to the EPC computer between runs or during a run.
4. Signal data – Save real time signal data and upload signal data from EPC to host PC for analysis after the target application is finished running, or view signal data during the run.

### Creating a real time target application for a loopback or signal acquisition test:

1. Before starting any model, in *xpcsetup* window, select the appropriate mode for the xPC target embedded option, the type of host–target connection and its related properties. Click the update and boot floppy buttons.
2. Create a simple model in Simulink, like a second order system with a Sin wave input. Add blocks like gain and Mux from Simulink, and CAN bus blocks (setup, send and receiver) from xPC Target. Then set the properties for these selected blocks.
3. Enter and select parameters in the **Simulation Parameters** dialog box.
4. Add an xPC Target Scope block to visualize signals while running the target application, you can add as many target scopes as you want in order to monitor various signals on your target PC.
5. Enter scope parameters in the **Block Parameters** dialog box before building the target application.
6. At this stage, you can include any custom C code files and any xpc target drivers for your PC/104 interfaces into your model.
7. From Real Time workshop tab, pick “xPC target” for target configuration and select all necessary options. Click the *Build* button. This will create and download the target application on to your EPC.

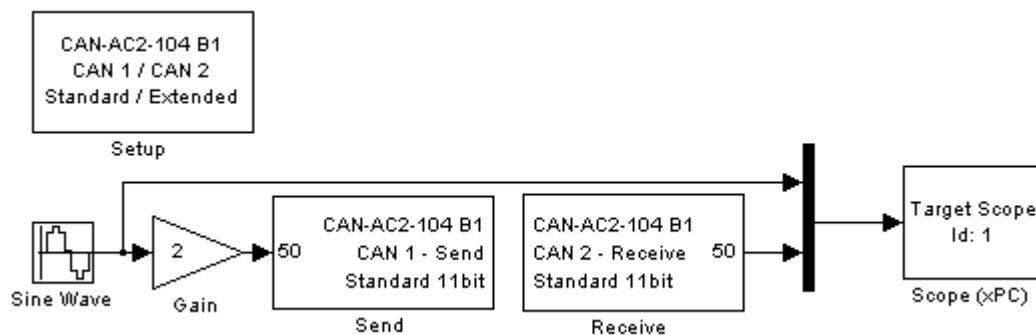


Figure shows a Simulink model for a loopback test on EPC with CAN bus. After the compiling, linking, and downloading process, a target object is created in your MATLAB workspace. Now you can start, running and controlling the model to check Signal Acquisition.



## 4. EXAMPLES

### 4.1. Can Bus Application Using Two EPC-1000s

**Software and Hardware:** The same hardware and software as in chapter 3 is used in this section.

1. Connect the hardware between the host PC and the two EPC's using TCP/IP or RS232 communication.
2. Now connect the CAN ports/cards using a gender changer or null modem cable accordingly as shown below.
3. Use two different base addresses for each of the CAN buses (pick values of "0X240" and "0X300").
4. Build and download a target application "model1" on EPC1 and "model2" on EPC2.
5. Using the host PC, run the target application on each EPC and then monitor the output.
6. Time lag or synchronization is not an issue between the two EPC's, when dealing with the CAN signals.

The following is the hardware setup for a loop back test.

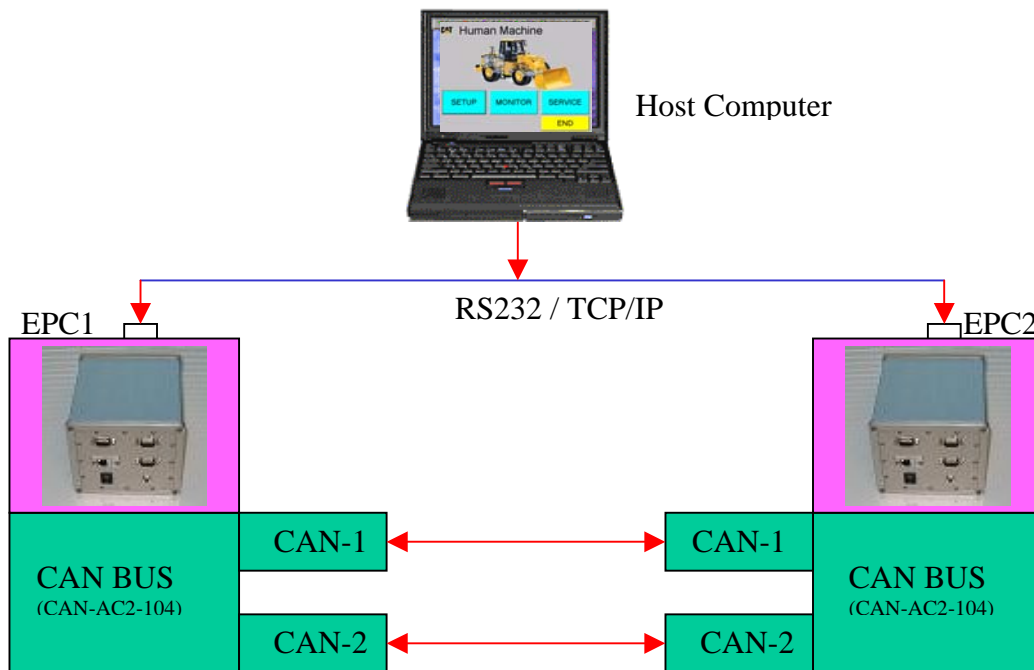


Figure 1 shows CAN Bus application using Two EPC's with CAN Bus card

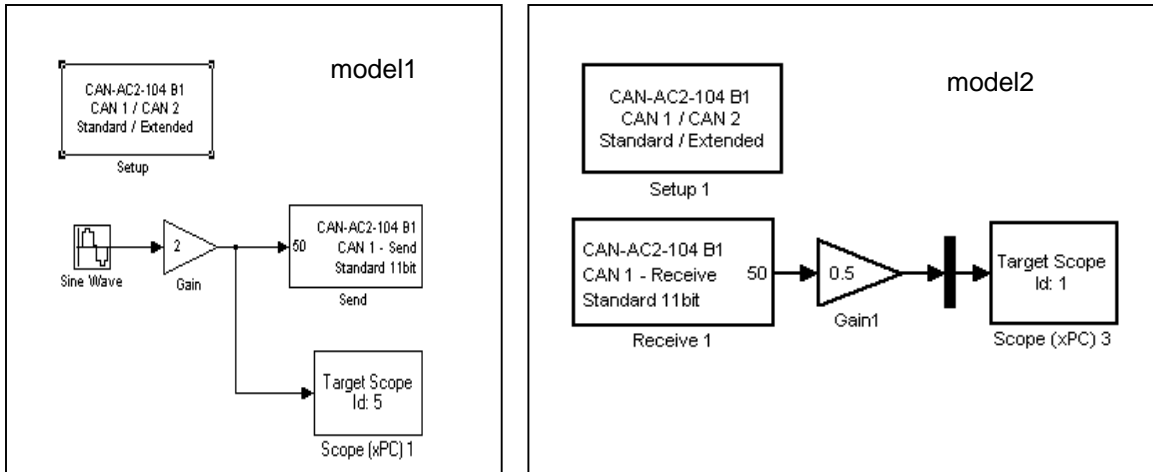


Figure 2 shows Simulink model1 and model2 for a loopback test using two xpc's with CAN bus

## 4.2. Can Bus Application Using EPC-1000 and CAT ABL Box

**Software:** In addition to the above-mentioned software tools, we also need Cat\_utilities toolboxes in order to run the ABL Box. RPAC (Rapid Prototyping for Automatic Controls) is a Matlab / Simulink library to support ABL2CS in this configuration.

The following table lists the I/O hardware boards :

Hardware	Description
CAN BUS	CAN – AC2 – 104 from Softing
ABL Box	ABL2CS V3 from Caterpillar

PIN selection on ABL Box :

1. CAN\_L(J1-6)
2. CAN\_H(J1-18)
3. CAN\_S(J1-19)
4. INPUT TO ABL/SWITCH6(J1-45)
5. INPUT TO ABL/SWITCH6(J2-56)
8. OUTPUT FROM ABL to bulb connector(+)(J2-64)
9. OUTPUT FROM ABL to bulb connector(-)(J2-52)
10. POWER TO ABL(+)(J2-70)
11. POWER TO ABL(-)(J2-69)
12. key switch for ABL Box (JI-58)

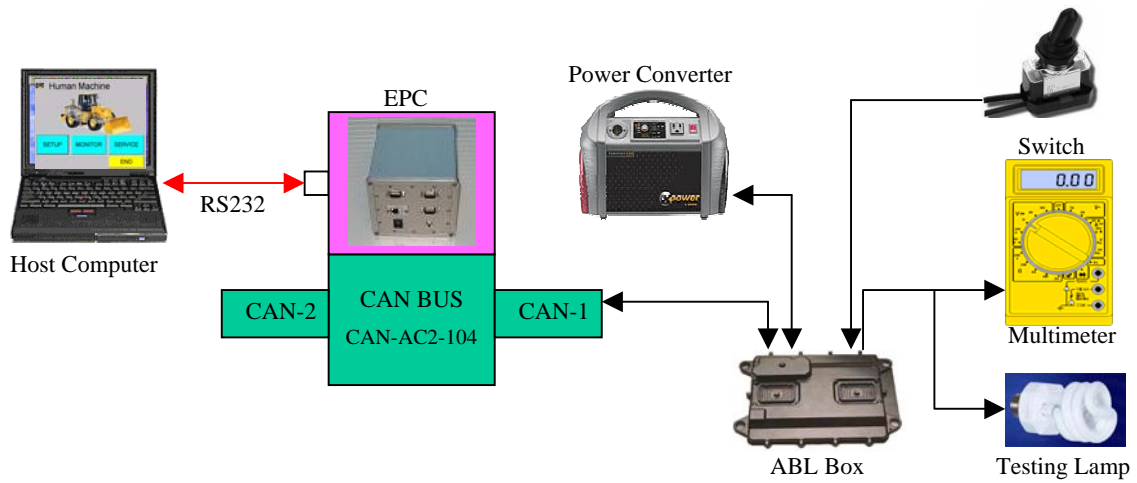


Figure 1 shows the hardware setup for ABL2CS V3 I/O's

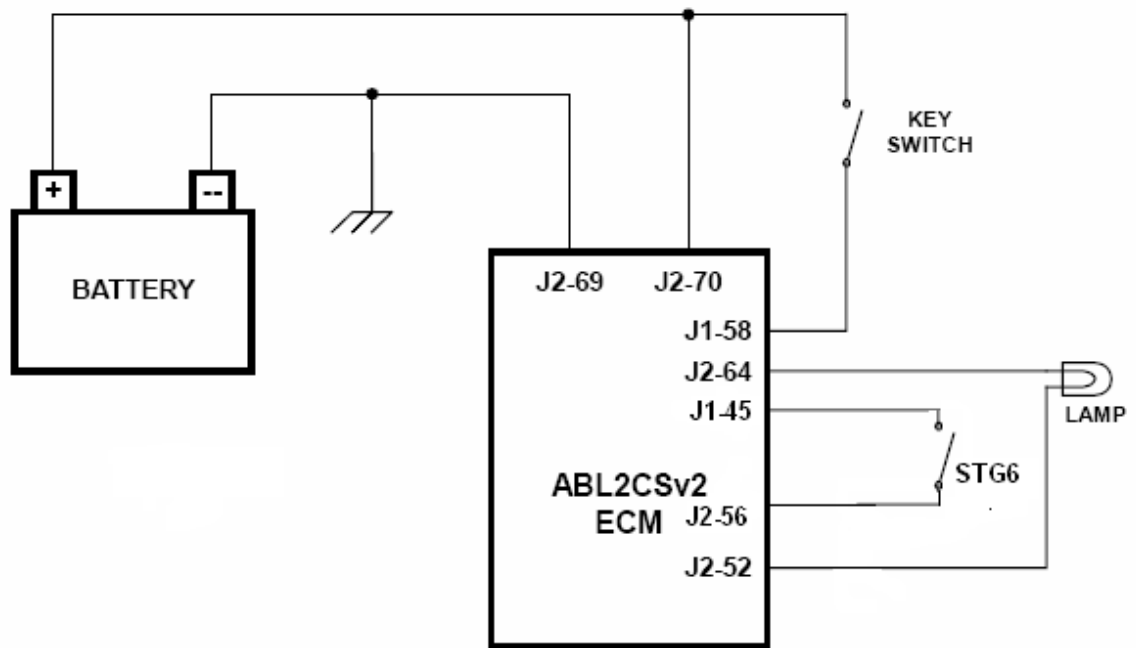


Figure 2 shows pin and circuit connections of ABL Box PWM driver outputs

1. This test model has an on/off switch, multimeter and a lamp to test the various I/O's. Complete the hardware setup and pin/circuit connections as shown above.

2. Set the I/O base address for the CAN bus as “0X240”, when using EPC with ABL box and never change it.
3. Using RPAC toolbox, select RPAC\_Config and RPAC\_ReadWrite\_IO blocks then complete I/O connections as shown below.
4. Add a gain block and a program with stateflow logic to turn switch on/off.
5. Build and download the target application on to your EPC using Real Time Workshop.
6. Run the target application by using host PC and monitor the outputs.

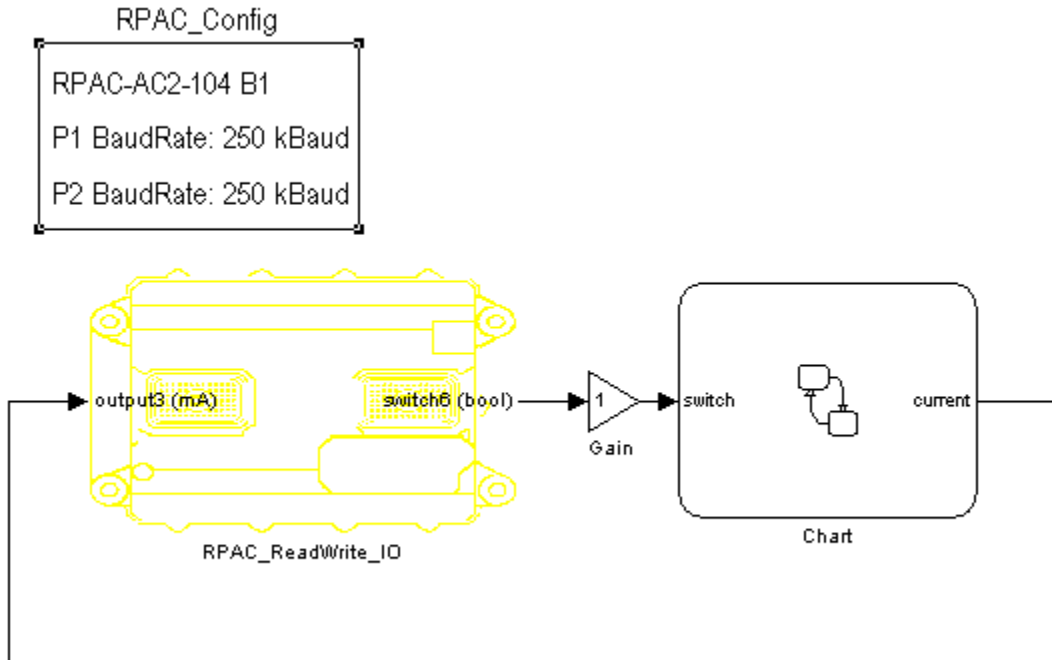


Figure 3 shows Simulink model using EPC with CAN bus and ABL2CS V3 I/O's

### 4.3. Analog and Digital I/O Application

#### **3. Analog and Digital I/O application using Diamond (DMM-32-AT) card :**

Software: Here we use the same software tools. Use the following paths to get into the Diamond board blocks,

- Matlab / Simulink / xPC Target / A/D / Diamond / MM-32 // Analog Input
- Matlab / Simulink / xPC Target / D/A / Diamond / MM-32 // Analog Output
- Matlab / Simulink / xPC Target / Digital Input / Diamond / MM-32 // Digital Input
- Matlab / Simulink / xPC Target / Digital Output / Diamond / MM-32 // Digital Output

The following table lists the additional hardware required for this application:

Hardware	Description
Analog I/O Digital I/O	DMM – 32 – AT from Diamond systems (Optional on EPC-1000)
Oscilloscope	2201 Analog / Digital storage oscilloscope from Tektronix

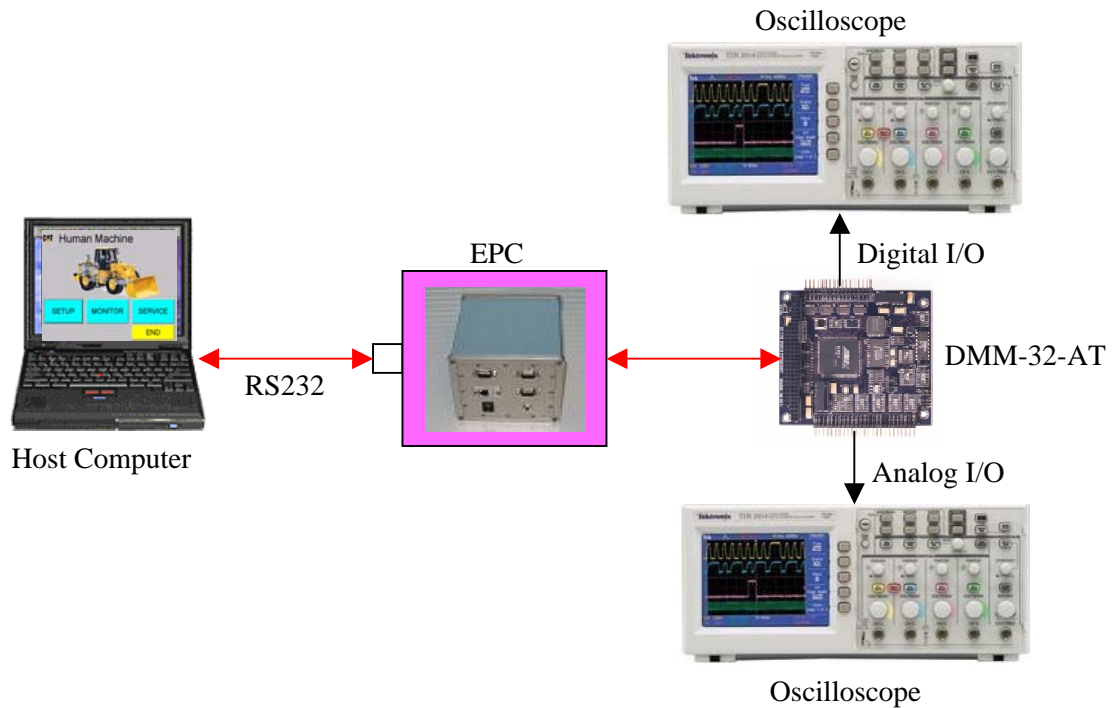


Figure 1 shows hardware setup for Diamond(DMM-32-AT) board I/O's

1. Connect the Laptop to the EPC using RS232 / TCP/IP communication and hook up the Diamond board with the Oscilloscopes in order to complete hardware setup.
2. For real time implementations, remove all input and output components(Function generator, Display, Scope, etc.) for the purpose of debug and analysis.
3. Provide I/O to Simulink blocks using "Input" and "Output" which will be connected to Diamond (DMM-AT-32) board.
4. Build and download the target application using the above Diamond blocks.
5. Run and monitor the model.



## 5. CONTACT INFORMATION

For any questions, please contact us.

Address: Servo Tech Inc  
1747 W. Roosevelt Rd, Suite # 110  
Chicago, IL, 60608

Phone: (312) 355-4853  
Fax: (312) 355-2021  
Web: [www.servotechinc.com](http://www.servotechinc.com)